


PARKER BLOWDOWN COOLING ASSEMBLY INSTALLATION DRAWING

NOTES:

- 1.) BLOWDOWN COOLING ASSEMBLY IS SHOWN DOUBLE LINE, FIELD PIPING IS SHOWN SINGLE LINE.
- 2.) COOLING ASSEMBLY IS FACTORY ASSEMBLED & SHIPPED NOT ATTACHED TO TANK. UNIT MUST BE SCREWED ONTO BLOWDOWN TANK OUTLET.

VENT THRU ROOF
INDEPENDENTLY
ROUTED, FULL SIZE

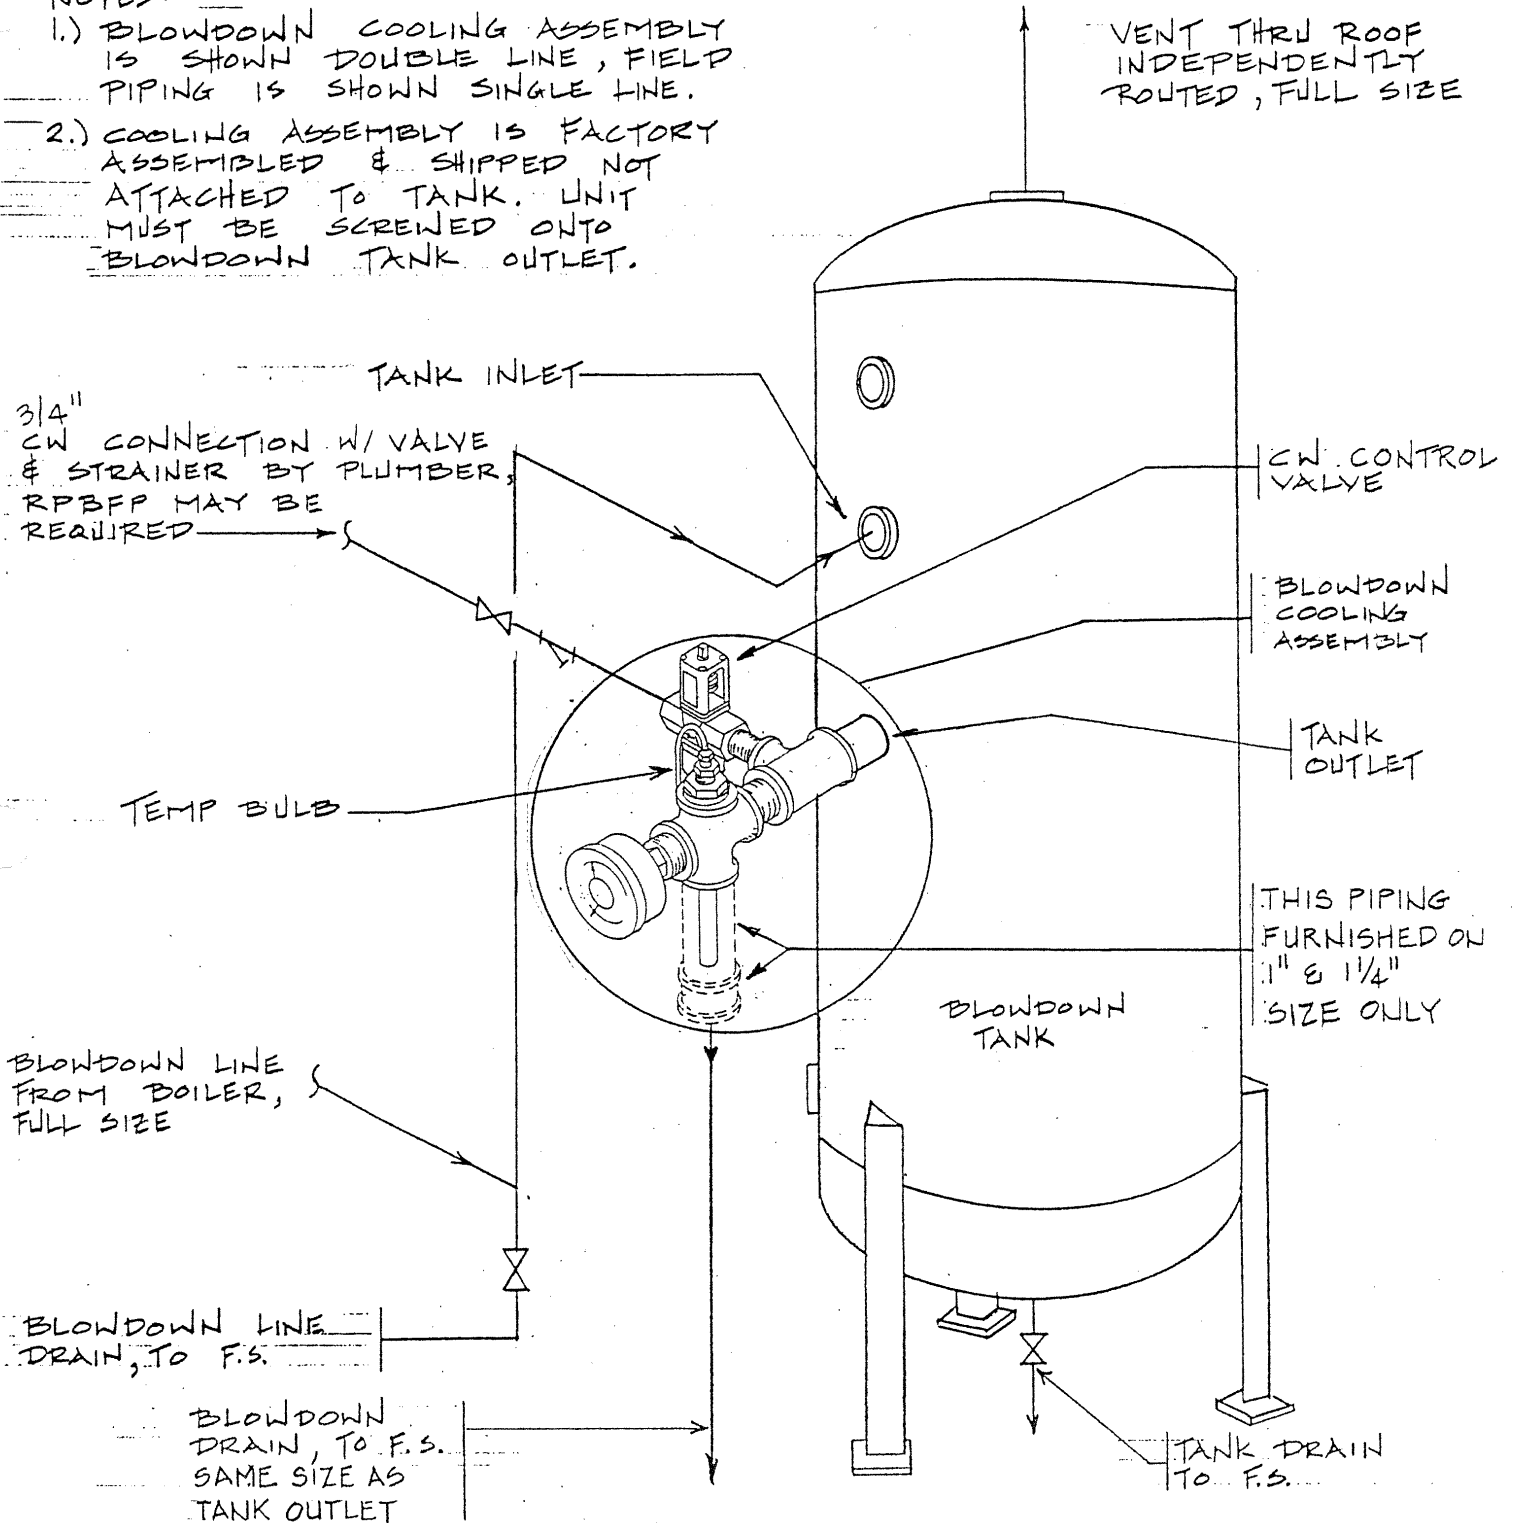

USED ON BLOWDOWN TANKS FOR INSTALLATION	PART NAME BLOWDOWN COOLING ASSEMBLY
--	--

MSL	DATE 5/92	PARKER BOILER CO. 5930 BANDINI BLVD. LOS ANGELES, CALIF. 90040-2999	SCALE NONE SUPERCEDES NO. 4/92 4/88 DWG. NO. A-115-BDCA-INST.
CH.			
APPROVED			