
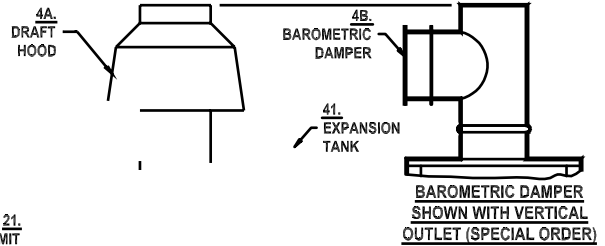


MINIMUM LISTED CLEARANCES TO COMBUSTIBLE CONSTRUCTION:	
TYPE	LENGTH (IN)
CABINET SIDES & REAR	12
CABINET TOP	48
DRAFT HOOD VENT CONNECTOR	6
BARO. DAMPER CHIMNEY CONNECTOR	12
RECOMMENDED CLEARANCES FOR ACCESS:	
TYPE	LENGTH (IN)
INSPECTION DOORS	18
FRONT ELECTRICAL PANEL	30
FRONT FOR 3PH	36
FRONT CABINET FOR EXCHANGER REMOVAL	1WA + 10
ADDITIONAL SPACE MAY BE REQUIRED BY LOCAL CODES	

20. PRESSURE GAUGE

25. PREMIX BLOWER

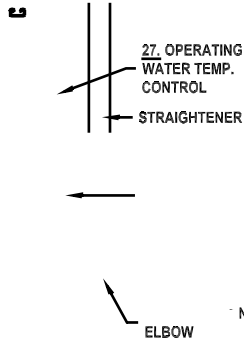

21. HIGH LIMIT

