


SINGLE BOILER HOT WATER PIPING SYSTEM

NOTE:

System pump should run at all times boiler is energized. When heat is no longer required, electrical power to boiler should be disconnected and pump should run for 5 - 15 minutes before being turned off.,

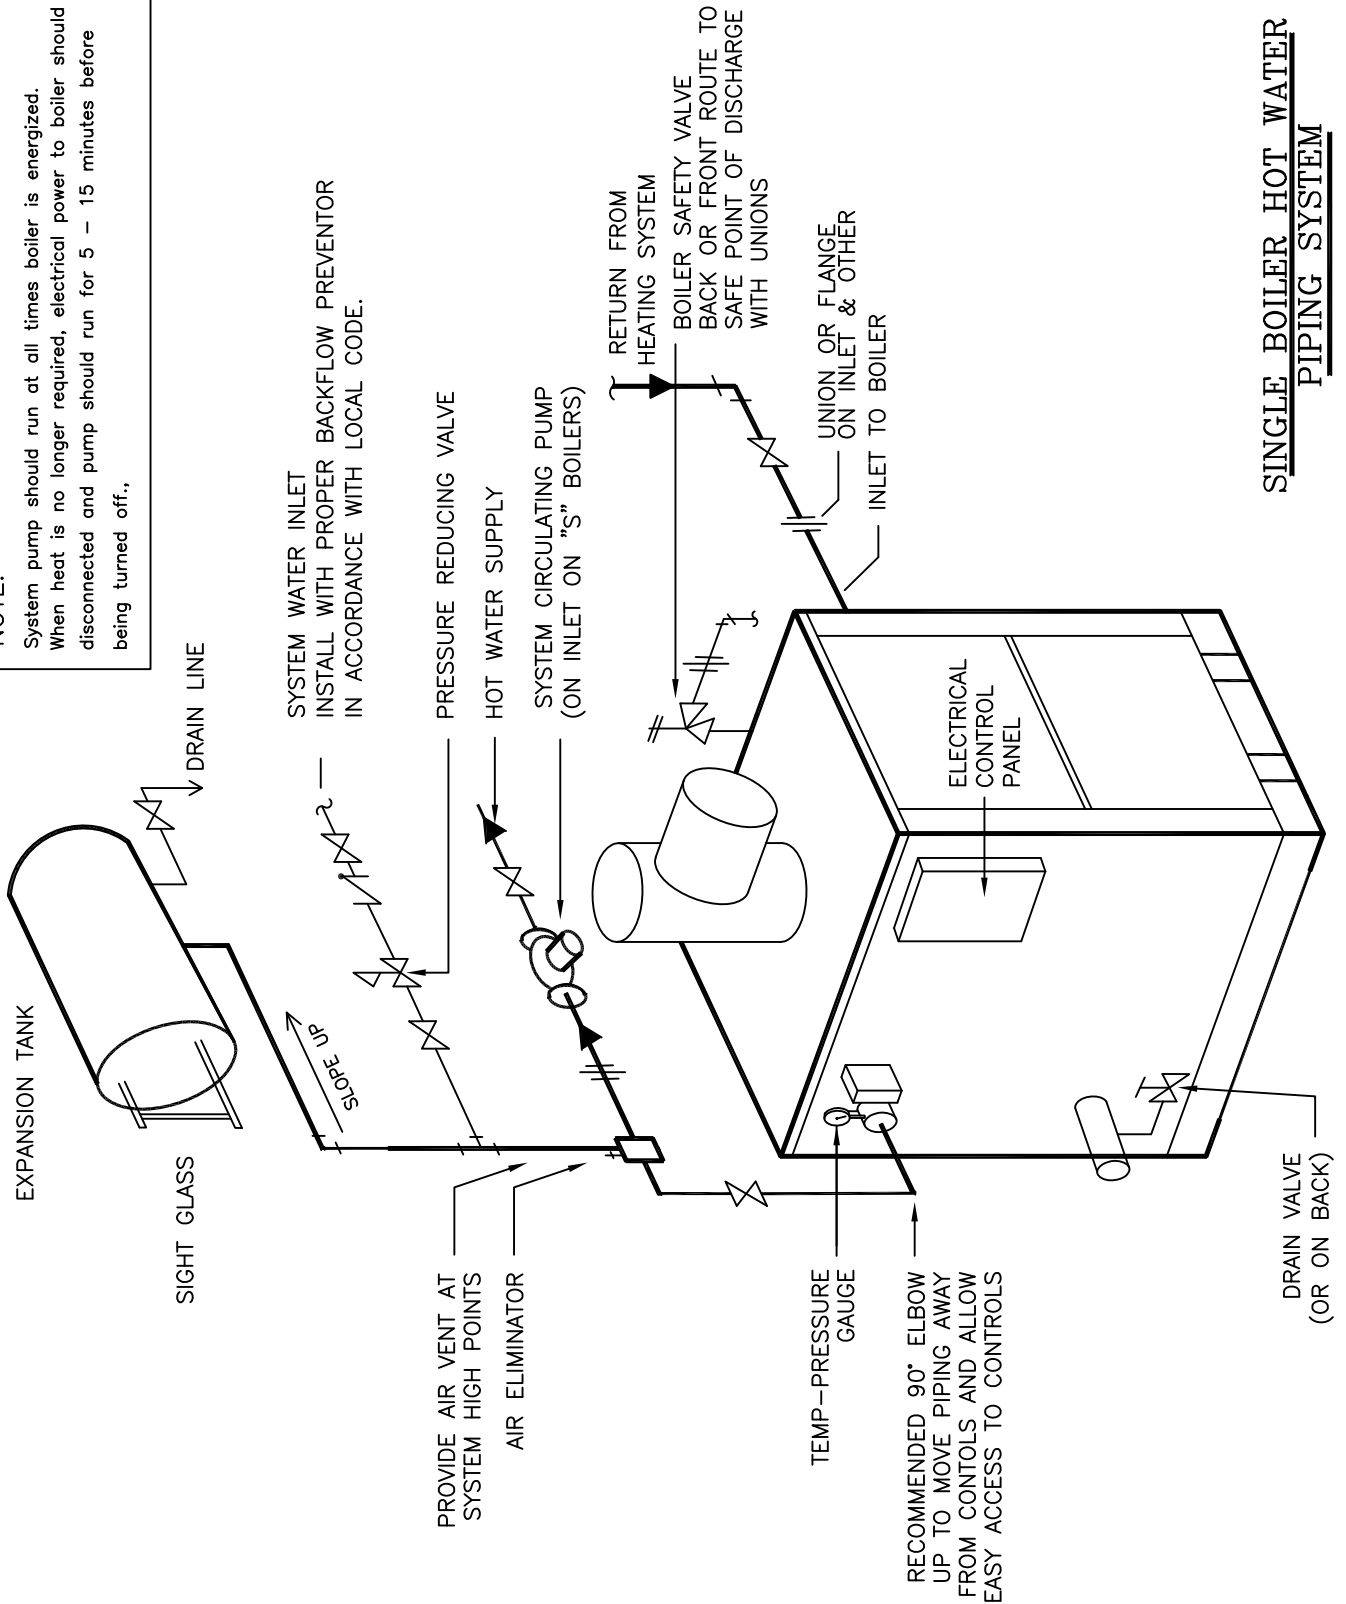

USED ON PARKER WATER WALL HOT WATER SYSTEMS

PART NAME GENERAL BOILER PIPING SCHEMATIC

FOR DIRECT FIRED, CLOSED SYSTEM HEATING

DR. FDL DATE 4/21/10

PARKER BOILER co.

SCALE NONE

CH.

5930 BANDINI BLVD.
LOS ANGELES, CALIF. 90040

SUPERCEDES NO. 11/6/08

APPROVED

DWG. NO. A-204-INST